



INSTALLATION VIEW

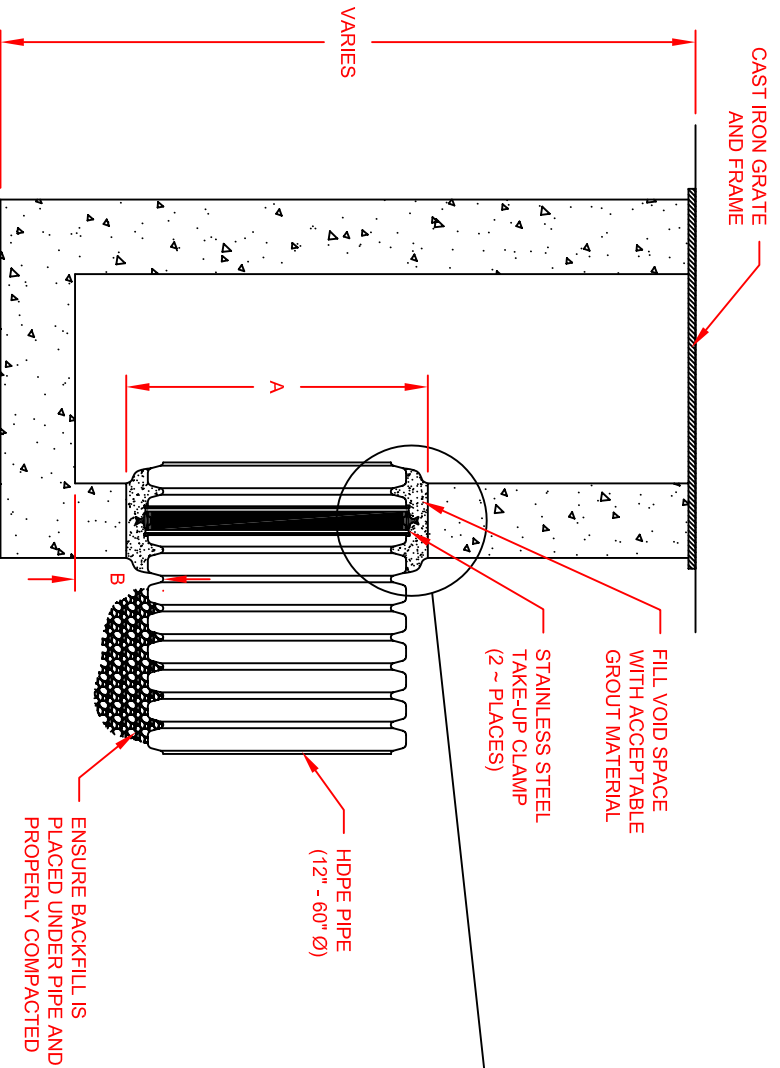

DETAILED CONNECTION VIEW

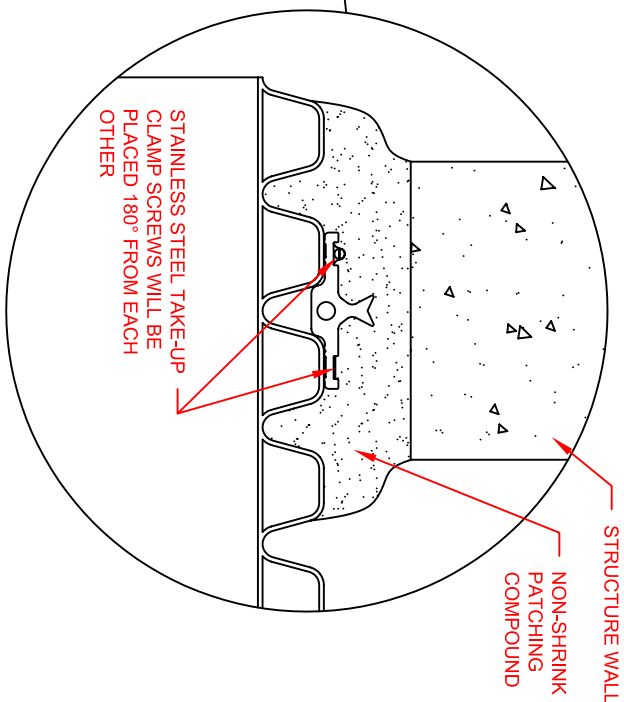

TYPE 3: WATERSTOP™ GASKET W/
CORRUGATED HDPE PIPE

INSTALLATION RECOMMENDATIONS ARE ALSO SPECIFIED IN
INSTALLATION GUIDE 1.05: WATERSTOP INSTALLATION

| PIPE SIZE (IN) | PIPE OD (IN) | "A" MIN. HOLE Ø (IN) | "B" MIN. DISTANCE PIPE INVERT TO STRUCTURE INVERT (IN) | MANUFACTURER'S PRODUCT CODE |
|----------------|--------------|----------------------|--|-----------------------------|
| 12 | 14.5 | 14.2 | 19.50 | 1202PS |
| 15 | 17.6 | 17.8 | 23.00 | 1502PS |
| 18 | 21.2 | 21.5 | 26.50 | 1802PS |
| 24 | 27.8 | 28.4 | 33.25 | 2402PS |
| 30 | 35.1 | 35.5 | 40.50 | 3002PS |
| 36 | 41.1 | 41.4 | 47.00 | 3602PS |
| 42 | 47.7 | 48.0 | 53.00 | 4202PS |
| 48 | 53.6 | 54.0 | 59.00 | 4802PS |
| 60 | 66.3 | 67.3 | 72.00 | 6002PS |

© 2007 HANCOR, INC.

HANCOR, INC. HAS PREPARED THIS DETAIL BASED ON INFORMATION PROVIDED TO HANCOR. THIS DRAWING IS INTENDED TO DEPICT THE COMPONENTS AS REQUESTED. HANCOR HAS NOT PERFORMED ANY ENGINEERING OR DESIGN SERVICES FOR THIS PROJECT, NOR HAS HANCOR INDEPENDENTLY VERIFIED THE INFORMATION SUPPLIED. THE INSTALLATION DETAILS PROVIDED HEREIN ARE GENERAL RECOMMENDATIONS AND ARE NOT SPECIFIC FOR THIS PROJECT. THE DESIGN ENGINEER SHALL REVIEW THESE DETAILS PRIOR TO CONSTRUCTION. IT IS THE DESIGN ENGINEER'S RESPONSIBILITY TO ENSURE THE DETAILS PROVIDED HEREIN MEETS OR EXCEEDS THE APPLICABLE NATIONAL, STATE, OR LOCAL REQUIREMENTS AND TO ENSURE THAT THE DETAILS PROVIDED HEREIN ARE ACCEPTABLE FOR THIS PROJECT.

| REV. | DESCRIPTION | TJR | DATE | CHKD |
|------|-----------------|-----|----------|------|
| 1 | UPDATED DRAWING | | 02/21/07 | CKS |

WATERSTOP STRUCTURE
CONNECTION DETAIL

DRAWING NUMBER: STD-203



| | |
|-------|---------|
| DATE | 10/1/06 |
| SCALE | NTS |
| SHEET | 1 OF 1 |